



DINYBULU
REGIONAL SERVICES
RAMINGINING



Proudly part of the ALPA group

HHIPN00006 Ngangalala Housing Upgrades

House 14 - Ngangalala

Completion Report

TABLE OF CONTENTS

Project Summary	3
Visual Progress	7
Attachments	10

P
M
E
W

08 8944 5961

0458 736 588

Admin.Dinybulu@alpa.asn.au

www.alpa.asn.au/dinybulu

Address: Lot 95 Ganinydja Road, Ramingining, NT 0822

Postal address: GPO Box 3825, Darwin, NT 0801

ABN 40 623 374 304



Service Provider:	Dinybulu Regional Services
Contact Details:	Catherine Main
ABN:	BUKMAK Constructions 53 374 103 051
Contractor Accreditation Limited (CAL) Registration Number:	D-6-18229-08-24
Community ID:	542
Asset No:	Lot 14
Contract No:	HHIPN00006
Completion Date:	17 July 2024

Project Summary – House 1

Dinybulu Regional Services have subcontracted BUKMAK Constructions and have completed the housing upgrade works of House 16, on behalf of the NT Government and local Ngangalala Homeland community residents.

The works have been completed in accordance with the submitted scope of works and saw the final product delivered to the high quality expected by our customer and community.

The mentioned works at House 14, Ngangalala commenced 12th June 2024 and was completed on the 17th July 2024 representing an four (4) week works program.

In the delivery of this project the local indigenous engagement exceeded 3 people directly associated with this project employed by Dinybulu Regional Services, and there are 3 indigenous trades mentors working on the delivery of these works too.

Bukmak have been engaged to deliver the following housing upgrade works for House 14, Ngangalala Homeland as a part of the Capital Grant Funding Agreement (HHIPN00006) - 10 Housing Upgrades – Ngangalala. The competed works are as follows:

SCOPE:

Ngangalala

House 14

Scoping date - 05/12/23

Throughout the Dwellings

Exterior Pressure wash (Approximately 142m²)
Internal Pressure wash (Approximately 308m²)
Internal wall painting (Approximately 308m²)
Ceiling painting (Approximately 76m²)
Doors and frames to paint (9 Each)
Replacing 600mm Louver blades (12 Each)
Replacing 600 x 1800 louver galleries (4 Each)

Exterior

Pressure Clean
Replace 6 step treads
Demo existing deck Front and rear
New Mod Wood deck front 40m²
New Mod Wood deck rear 13m²
Replace 5 L/M of 150 Galv Verim mesh to eve
External Garden tap needs replacing

Lounge/Kitchen

Replace Solid core door + Passage + Vandal Plate - Pantry
Replace Solid core door + Entrance + Vandal Plate (2 Each)
Replace Kitchen Sink mixer with SS mixer.
Service louver Galleries
Replace Fly Screen Mesh - allow 1800 x 2000mm (2 Each)

Bathroom 2m x 3m

Replace Solid core door + Privacy set + Vandal Plate (2 Each)
Re Sheet Existing Bathroom and WC with 6mm FC Sheet
Replace Vanity and with stainless basin and mirror
New shower taps and rose + soap holder
New toilet
Re tile and waterproof shower and floor
Service louver galleries

Laundry 2 x 3 m

Replace Solid core door + Entrance + Vandal Plate
Re tile laundry area to match bathroom
Install new tapware to laundry stainless steel

Bedroom 1

Replace Solid core door + Privacy set + Vandal Plate
Service Louver Galleries
Replace Fly Screen Mesh (allow 1800 x 2000)
Patch Old AC hole 1000 x 1000 with 6mm FC Sheet

Bedroom 2

Replace Solid core door + Privacy set + Vandal Plate
Service Louver Galleries
Replace Fly Screen Mesh (allow 1800 x 2000)
Patch Old AC hole 1000 x 1000 with 6mm fc sheet

Bedroom 3

Replace Solid core door + Privacy set + Vandal Plate
Service Louver Galleries
Replace Fly Screen Mesh (allow 1800 x 2000)

Electrical Works

Note – In the absence of a pre scope inspection by a qualified electrician as to total works required to enable issue of an Electrical Certificate of Compliance (COC) on completion, Bukmak's price is based on the maximum of replacing the following items. If on attending the dwelling, additional works are required over and above the identified below (item & quantities), additional works will be extra to the lump sum amount.

Replace/Supply and Install hardwired smoke detectors in compliance with NCC and AS3786 (2 Each)
Check earth stakes are compliant with NCC AS 3000 (1 Each)
Check all electrical circuits and RCDs and issue electrical CoC in accordance with Australian Standards (1 Each)
Replace / Supply and Install double GPO (8 Each)
Replace / Supply and Install W/P double GPO (4 Each)
Supply and Installation of 300mm Exhaust fan (1 Each)
Replace / Supply and Install stove isolator switch (1 Each)
Replace / Supply and Install stove power outlet (1 Each)
Replace / Supply and Install stove including vermin kit utilising existing cabling - plug in (1 Each)
Supply and Installation of lockable circuit breaker including reporting to PWC (1 Each)
Remove existing light fitting and replace with LED Oyster light fitting (5 Each)
Remove existing light fitting and replace with W/P LED Oyster light fitting (3 Each)
Replace / Supply and Install double gang combination (5 Each)
Replace / Supply and Install light switch with W/P light switch (3 Each)

Approved Variation/s

BUK2118 – HHIP Ngangalala
Lot #14
Variation #34 – Extra Electrical

Dear Catherine,

Please see Request for Variation #34 for Extra Electrical required at Lot 14 Ngangalala – details of Scope on page 2.

The value of Variation #34 is \$5,924.00 excluding GST

LOT 14


Category	Item Ref	Description	Original Qty (Scope)	Actual Qty (Electrician Report)	Qty Variance
LIGHTS, SWITCHES, FANS	137	Remove existing light fitting and replace with LED Oyster light fitting	5	8	3
	138	Remove existing light fitting and replace with W/P LED Oyster light fitting	3	0	-3
	145	Remove existing light fitting and replace with 600 W/P LED light fitting	0	1	1
	147	Remove existing light fitting and replace with 1200 W/P LED Bitem light fitting	0	3	3
	148	Replace / Supply and Install 1400 dia ceiling fan including controller	0	6	6
	150	Replace / Supply and Install light switch	0	2	2
	151	Replace / Supply and Install double gang combination	5	5	0
	153	Replace / Supply and Install light switch with W/P light switch	3	1	-2
GENERAL WORKS	174	Electrician	0	2	2
SMOKE DETECTOR	178	Replace / Supply and Install hardwired smoke detectors in compliance with NCC and AS3786	2	1	-1
GENERAL	179	Check earth stakes are compliant with NCC AS 3000	1	1	0
	181	Check all electrical circuits and RCDs and issue electrical CoC in accordance with Australian Standards	1	1	0
DOUBLE GPO	185	Replace / Supply and Install double GPO including wiring	8	13	5
	187	Replace / Supply and Install W/P double GPO including wiring	4	2	-2
ELECTRIC STOVE	189	Supply and installation of 300mm Exhaust fan	1	0	-1
	190	Replace / Supply and Install stove Isolator switch including wiring to switchboard	1	1	0
	191	Replace / Supply and Install stove power outlet including wiring to switchboard	1	1	0
	192	Replace / Supply and Install stove including vermin kit utilising existing cabling (plug in)	1	1	0
	193	Replace / Supply and Install anti tilt bracket to stove	0	1	1
SWITCHBOARD	195	Supply and installation of lockable circuit breaker including reporting to PWC	1	1	0
	201	Supply and Install RCD on an electrical circuit	0	7	7
	203	New SB enclosure. Works include: - File NIW paperwork to PAWA; - Pull fuse to house shutting down Supply; - Remove items in existing switch board enclosure such as meters and associated components; - Remove and replace enclosure like for like running cabling into new enclosure; - Re install meter and all required components circuit breakers etc.; and, - Re install power to house and carry out testing as required.	0	1	1
		*** Positive Value - means (Actual requirement is more)			
		*** Negative Value means (Actual requirement is less than what allowed in the scope)			

BUK2118 – HHIP Ngangalala
Lot #14
Variation #38 – Replace tiling in WC

Dear Catherine,

Please see Request for Variation #38 to remove and replace old tiles in the WC area at Lot 14 Ngangalala as it is not part of the original scope. The new tiles will be 200x200mm floor tiles and skirting tiles to maintain consistency with the wet area (4m²), along with strengthening the waterproofing application over the entire floor.

The value of Variation #38 is \$3,125.00 excluding GST

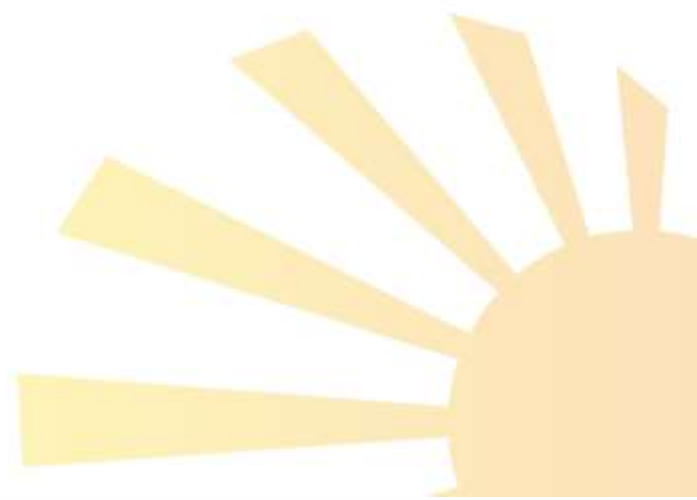




Visual Progress:

Before:




After:

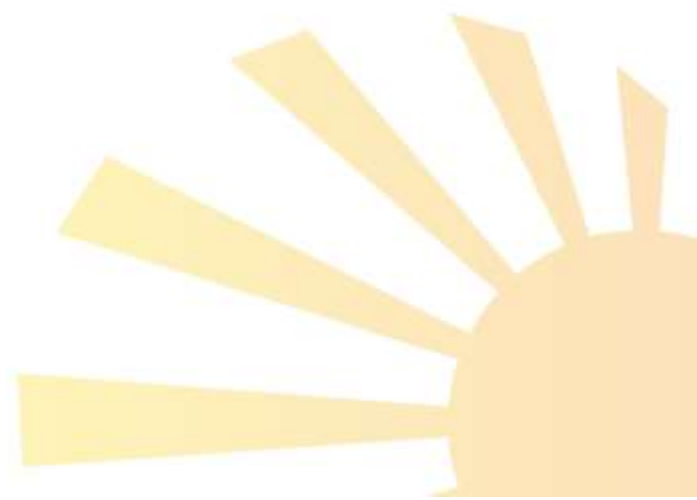










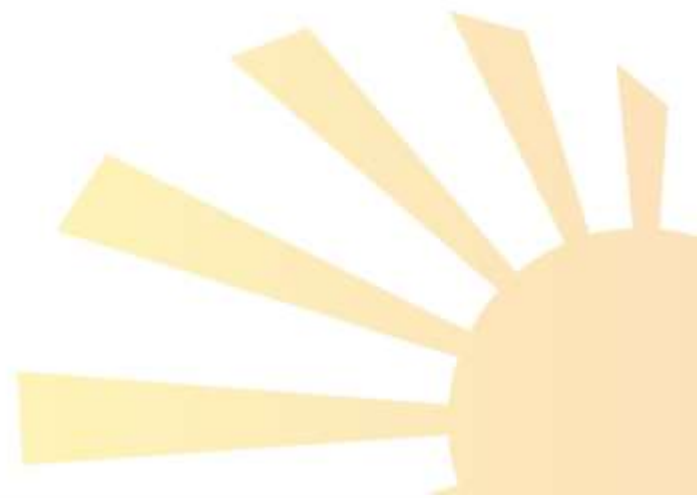

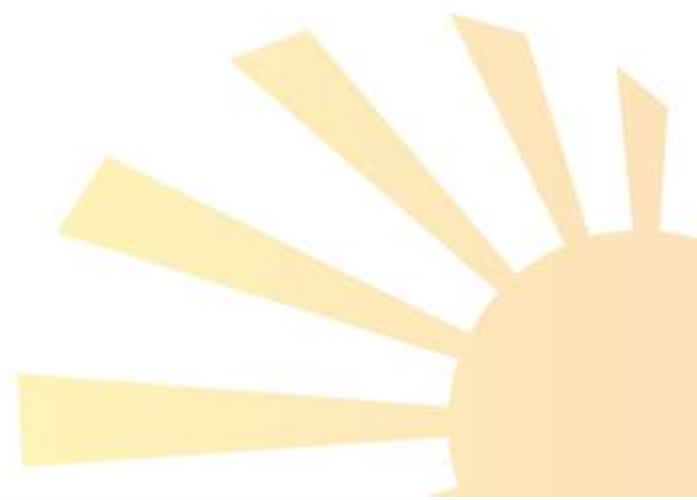

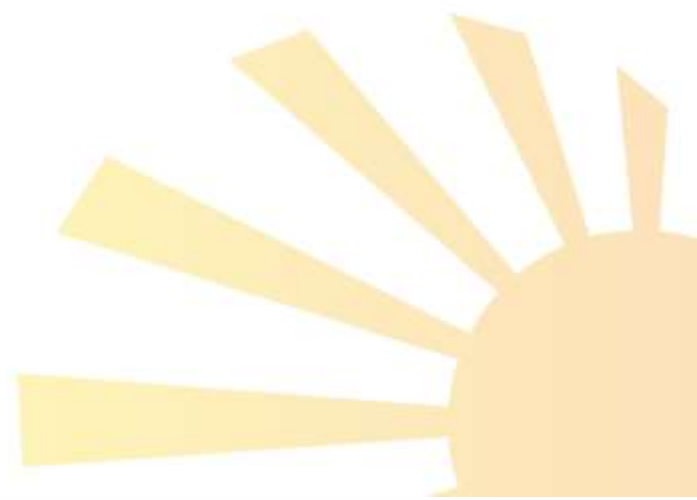

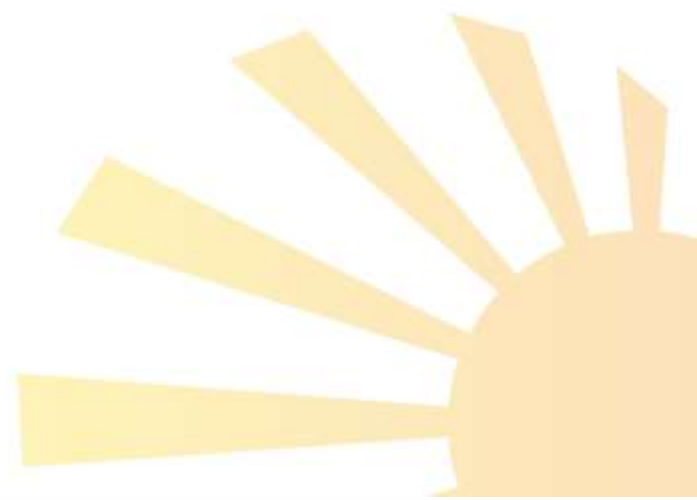











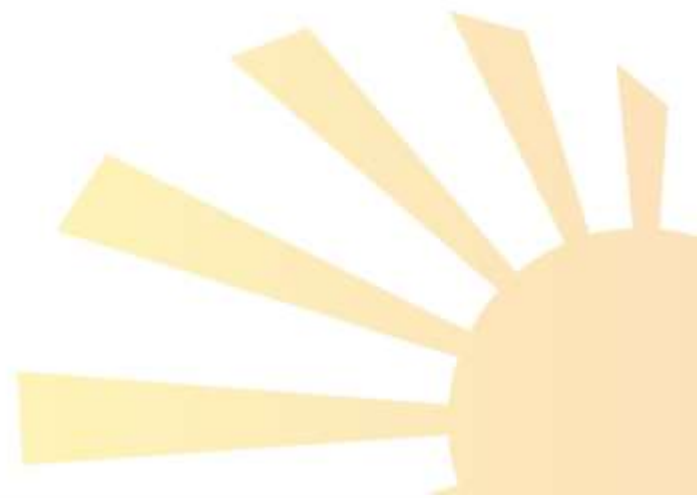

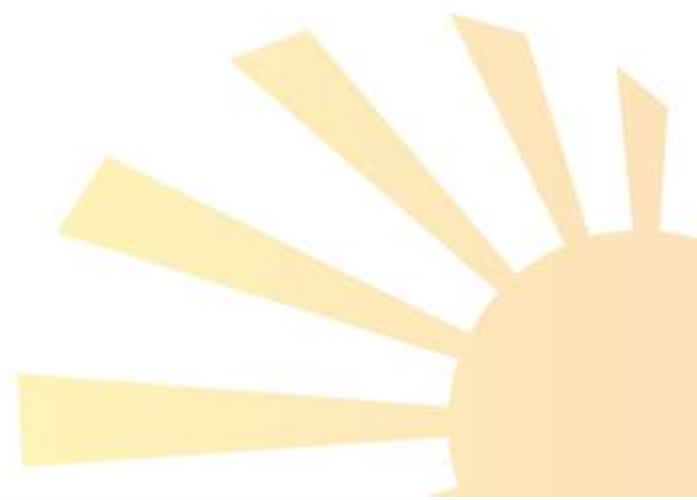


Attachments:

Electrical Certificate of Compliance

Plumbing Certificate of Compliance

Water Proofing Certificate

Serial Number, Warranty & Stove Booklet

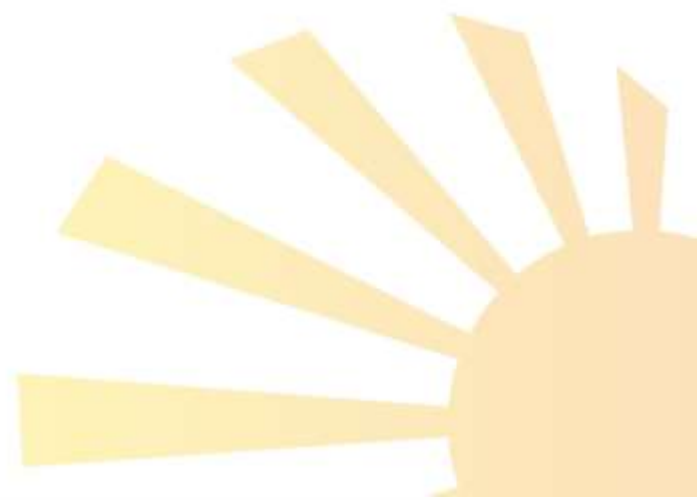

Solar Hot Water Report

SOLAR HWS:

The Solar hot water system at lot is currently working to create hot water, however the following issues have been identified.

1. Non-compliance with AS3500 Standards:

- The pipework and valves are currently not compliant with AS3500 standards, which may be contributing to the pressure drop and inefficiencies in your hot water system.
- Recommendation: Replace all old valves with new ones that meet AS3500 standards. Install stainless steel pipework to ensure compliance and durability. This upgrade should help improve the system's performance and longevity.


2. Expected Lifespan of Solar Panels and Tank:

- The solar panels and tank at House 14 have an expected lifespan of approximately 5-10 years.
- Consideration: Since these components have a limited lifespan, it's important to monitor their condition regularly. As they near the end of their lifespan, planning for replacement or upgrades will be necessary to maintain hot water supply.

3. Community Wide Water Pressure Issue:

- There's a community-wide water pressure issue affecting the solar system's operation at maximum capacity.
- Impact: Low water pressure can reduce the effectiveness of solar hot water systems, especially in heating water to the desired temperature efficiently.
- Potential Solution: Addressing the community-wide water pressure issue would benefit all residents, including improving the performance of your solar hot water system.

In summary, addressing compliance issues with AS3500 standards through valve replacement and stainless-steel pipework installation is crucial for improving your solar hot water system's efficiency and longevity. Additionally, keeping an eye on the lifespan of your current solar panels and tank and addressing community water pressure issues will help optimize the system's performance in the long run.

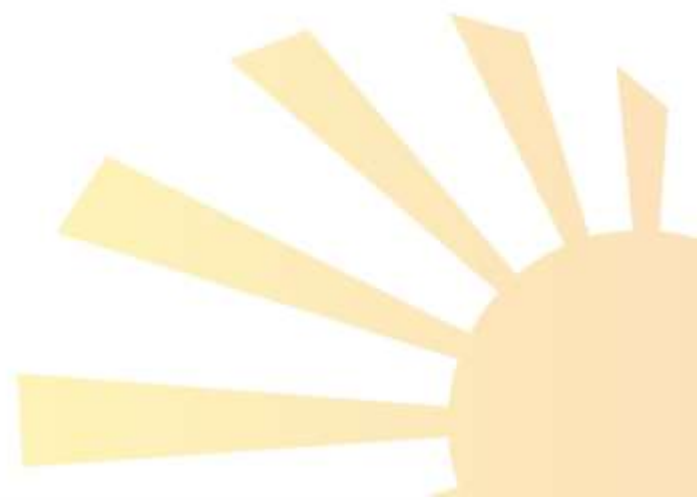



Septic Audit Report & Quote

SEPTIC SYSTEM:

Based on the information provided about the septic system at house 14, here are some recommendations regarding the installation of a new gravity-fed system:

Current System Description:

- The existing septic system at house 14 operates on a pump-out pit that transfers waste to a soakage trench.
- The drainage component and pumps of the system are in good working condition.

Proposed Recommendation

Install New Gravity-Fed System:

- This new system would eliminate the need for a pump to transfer water up to the current absorption trench, which is located above the natural ground level.

- Advantages

- **Reduced Maintenance:**

Gravity-fed systems generally require less maintenance compared to systems with pumps, which can be prone to mechanical issues over time.

- **Lower Operational Costs:**

Without the need for pumps, operational costs associated with electricity and pump maintenance would be eliminated.

- **Long-term Reliability:**

Gravity systems are often more reliable because they have fewer moving parts that can break down.

- **Environmental Benefits:**

Gravity-fed systems typically have lower energy consumption and can be more environmentally friendly.

- **Considerations:**

- **Initial Cost:** While installing a gravity-fed system may be more expensive initially due to excavation and installation costs, the reduced maintenance and operational costs over time can offset this initial investment.

- **Site Suitability:** Ensure that the site conditions and terrain are suitable for a gravity-fed system. Adequate slope and soil conditions are necessary for proper drainage and absorption.

Diagram Comparison:

- Including diagrams of the current pump-out pit system and the proposed gravity-fed system can visually illustrate the differences and benefits of the new system.




In conclusion, installing a new gravity-fed septic system at house 14 appears to be a beneficial upgrade, offering reduced maintenance, lower operational costs, and improved long-term reliability compared to the current pump-out pit system. It's important to assess the feasibility and costs associated with installation while ensuring the system meets local regulations and environmental requirements.

Current:




Please note: Septic systems vary. Diagram is not to scale.

Recommended:

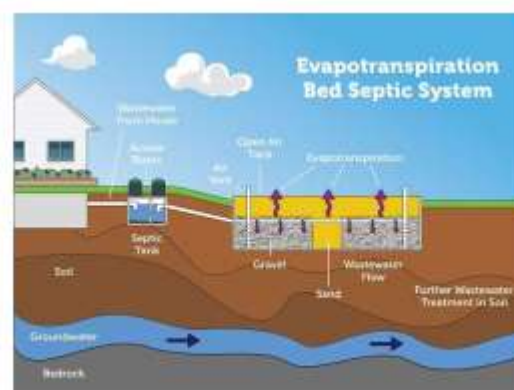


Please note: Septic systems vary. Diagram is not to scale.

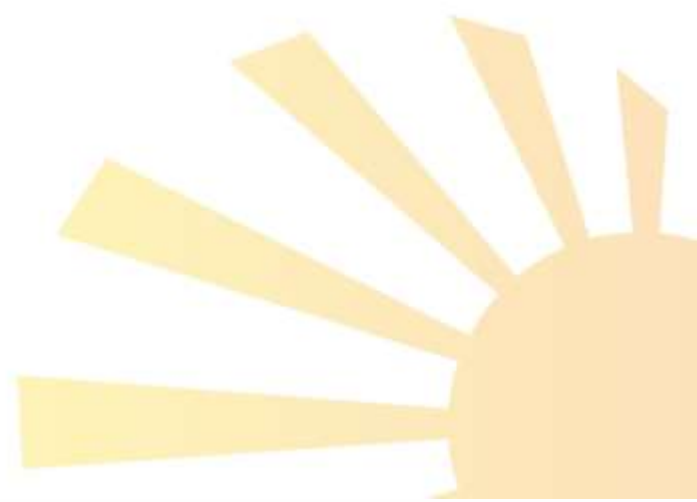

Serial Number, Warranty & Stove Booklet

Quick Start Guide

WLE522, WLE530, WLE532 series



Dear Customer,

Thank you for purchasing a Westinghouse appliance. You have chosen a product that comes from a history of durable and reliable products loved by many families. We look to help you make the most of your time at home, so you can spend your time doing what you really love, with the ones you love.

Welcome to Westinghouse.

Ready



This is a Quick Start Guide. Please refer to user manual online for detailed information and installation

To access your detailed user manual online, simply scan the QR code on your smart phone.

For more detailed information and installation guide refer to user manuals at westinghouse.com.au/manuals

Before you start, please make sure:


- Your cooker has been correctly installed by a qualified person.
- Your cooker has power and is switched on.
- You've removed all relevant packaging.




Most of the packaging materials can be recycled. Please dispose of them at your local recycling centre or in your own recycling bin.

Set...

Get to know the control panel:

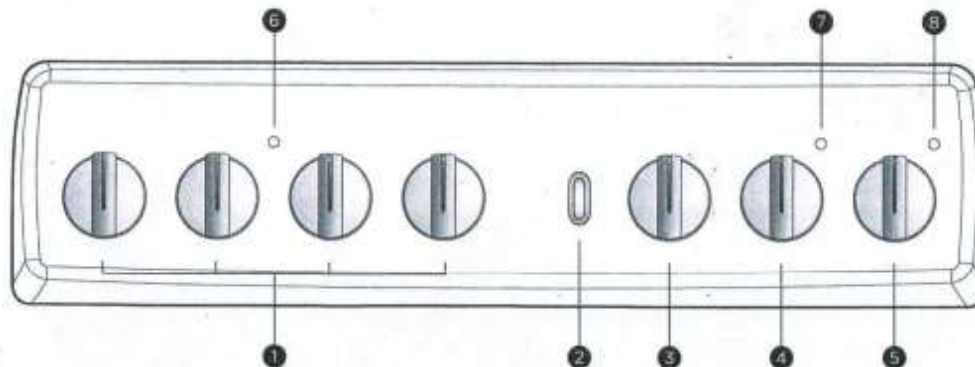

- | | | |
|--|----------------------------------|---------------------------|
| 1 Radiant/solid/ceramic cooktop temperature control knob | 3 60 minute timer | 6 Cooktop indicator light |
| 2 Oven light switch on/off (WLE530 model only) | 4 Grill temperature control knob | 7 Grill indicator light |
| | 5 Oven temperature control knob | 8 Oven indicator light |

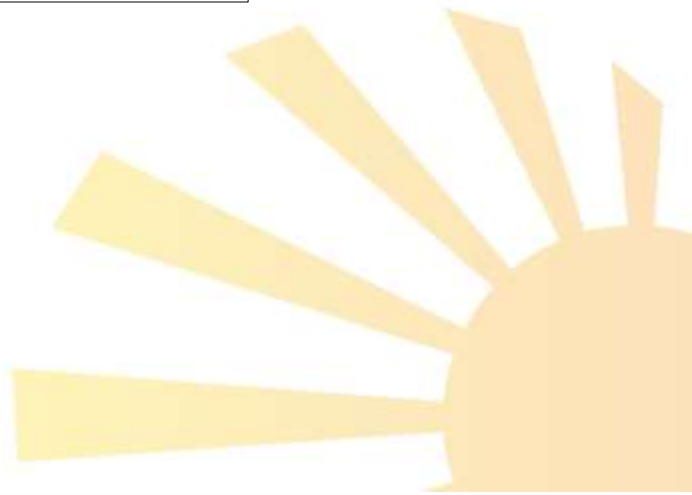

Ceiling Fan

Performance Range Sweep Fan

P3HS1200™, P3HS1400™, P3HS1600™, P3HS1800™, P3HS2000™, P3HS2200™, P3HS2400™, P3HS2600™, P3HS2800™, P3HS3000™ series

CLIPSAL

by Schneider Electric

Installation Instructions

For your safety

⚠ DANGER

HAZARD OF ELECTRIC SHOCK, EXPLOSION OR ARC FLASH

- This product must only be installed by appropriately qualified and/or licensed electrical personnel.
- Isolate the electrical supply before doing any work on this product.
- Ensure that the product has been correctly installed and tested for safe operation before reconnecting the electrical supply.

Failure to follow these instructions will result in death or serious injury.

⚠ CAUTION

IMPORTANT INSTALLATION SAFEGUARDS

- Means for disconnections must be incorporated in the fixed wiring in accordance with the wiring rules.
- The mounting bracket must be fixed to a solid structure, such as ceiling joist with sufficient strength to withstand 4 times the weight of the fan, 30 kg or intended (Figure 1).
- The fan should be mounted so that the blades are at least 2.1 m above the floor, and 300 mm from the tip of the blade to the nearest object or walls (Figure 2).
- Hangwire mounting is suitable for pitched ceilings with a maximum angle of 18.5° (Figure 3).
- The use of attachments not recommended or sold by appliance manufacturer may cause a risk of injury to person.
- The appliance is only intended for the purpose described in the user manual. Do not use the appliance or any part of the appliance out of the intended use to avoid risk.
- Replacement of parts of the safety suspension system device shall be performed by the manufacturer, its service agent or suitably qualified persons.

Failure to follow these instructions can result in injury, equipment damage or unnecessary vibration and noise.

⚠ CAUTION

IMPORTANT CLEANING SAFEGUARDS

- Isolate the electrical supply before doing any cleaning of this product.
- Regular cleaning of ceiling fan is required. It is recommended to clean every 3 months. Harsher environment may require more regular cleaning.
- Use a soft brush or lint free cloth to avoid scratching the paint finish.
- Do not use water when cleaning your ceiling fan as it could damage the motor or blades and possibility of an electric shock.
- The motor has a permanently lubricated ball bearing so there is no need of oil.

Failure to follow these instructions can result in injury or equipment damage.

⚠ CAUTION

INSTALLATION HAZARD

- To ensure proper balance, do not mix up blades with those from another fan as they are a matched set.
- Transport and transit handling may loosen factory fitted cables, please check and secure terminal screws before installation.
- Do not place motor on a flat surface. The plastic nipple underneath the motor control support the weight of the motor and may be easily damaged (Figure 4).
- When working on the fan, place motor on the foam packaging with the nipple located in one of the recesses. This protects the nipple and the finish (Figure 5).

Failure to follow these instructions can result in injury or equipment damage.

SEWFM

1. Technical data

Ceiling Sweep Fan series - Max weight 5.7 kg	
230-240 V AC, 50 Hz, 60W	230-240 V AC, 50 Hz, 60W
P3HS1200AL	P4HS1200AL
P3HS1200SS	P4HS1400AL
P3HS1400AL	P4HS1200AL
P3HS1400SS	P4HS1400AL
P3HS1200AL	
P3HS1400AL	

Figure 1

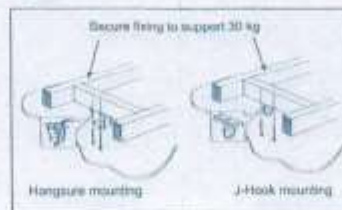


Figure 2

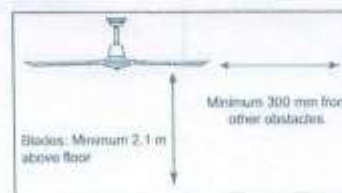


Figure 3

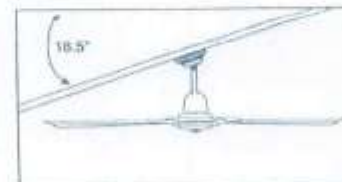


Figure 4


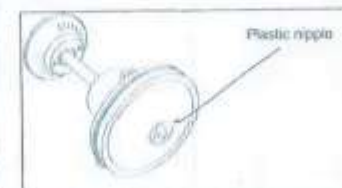


Figure 5

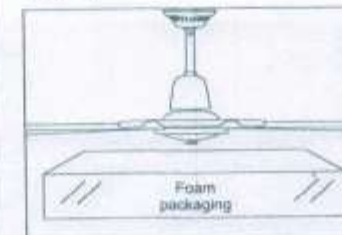


2. Pre-install Check

Prior to installation, carefully identify the parts (Figure 6.)

- (A) Motor Assembly
- (B) Blades (3 or 4 depending on model)
- (C) Three-Speed Fan Controller
- (D) Screw Pack
- (E) Mounting Bracket
- (F) Instruction Sheet

Figure 6

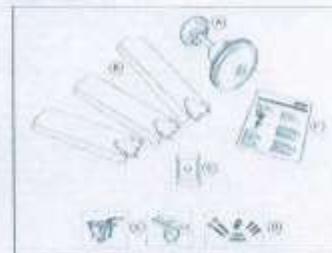

NOTE:

Controlling Single or Multiple Fans on Single Controller: This fan has been supplied with a Clipsal Three-Speed Controller that is designed to only operate a single fan.

If multiple fans are required to be operated from a single controller, a Clipsal G-Flex™ Electronic Fan Controller (purchased separately) must be used.

NOTICE


HAZARD OF INCORRECT USAGE

The three speed fan controller supplied with each fan is not suitable for controlling multiple fans.

Failure to follow these instructions can result in equipment damage.

3. Fitting the Blades

- 1 Place the motor over a foam packaging.
- 2 Place the blades over the motor and align the screws.
- 3 Secure the blade with screws.

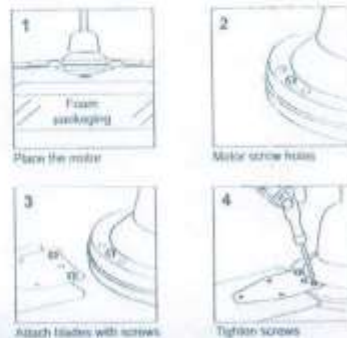

NOTE:

Connecting a Light Fitting: For information on how to connect a light fitting to the Ceiling Sweep Fan, refer to the instruction in the light fitting accessory (Cyber Light and Clipper Light).

Smoke Alarm

